



4251 N.E. Port Drive • Lee's Summit, MO 64064 • 800-554-8268





Owner & Assembly Manual

America's Best Tan™ TRIBUTE 36 100/160W


Les Spécifications Françaises Enclos

WIRING DIAGRAM TOP CONTROL BOX

PLUG &
RECEPTICAL
1 - WHITE
2 - BLACK
3 - GREEN

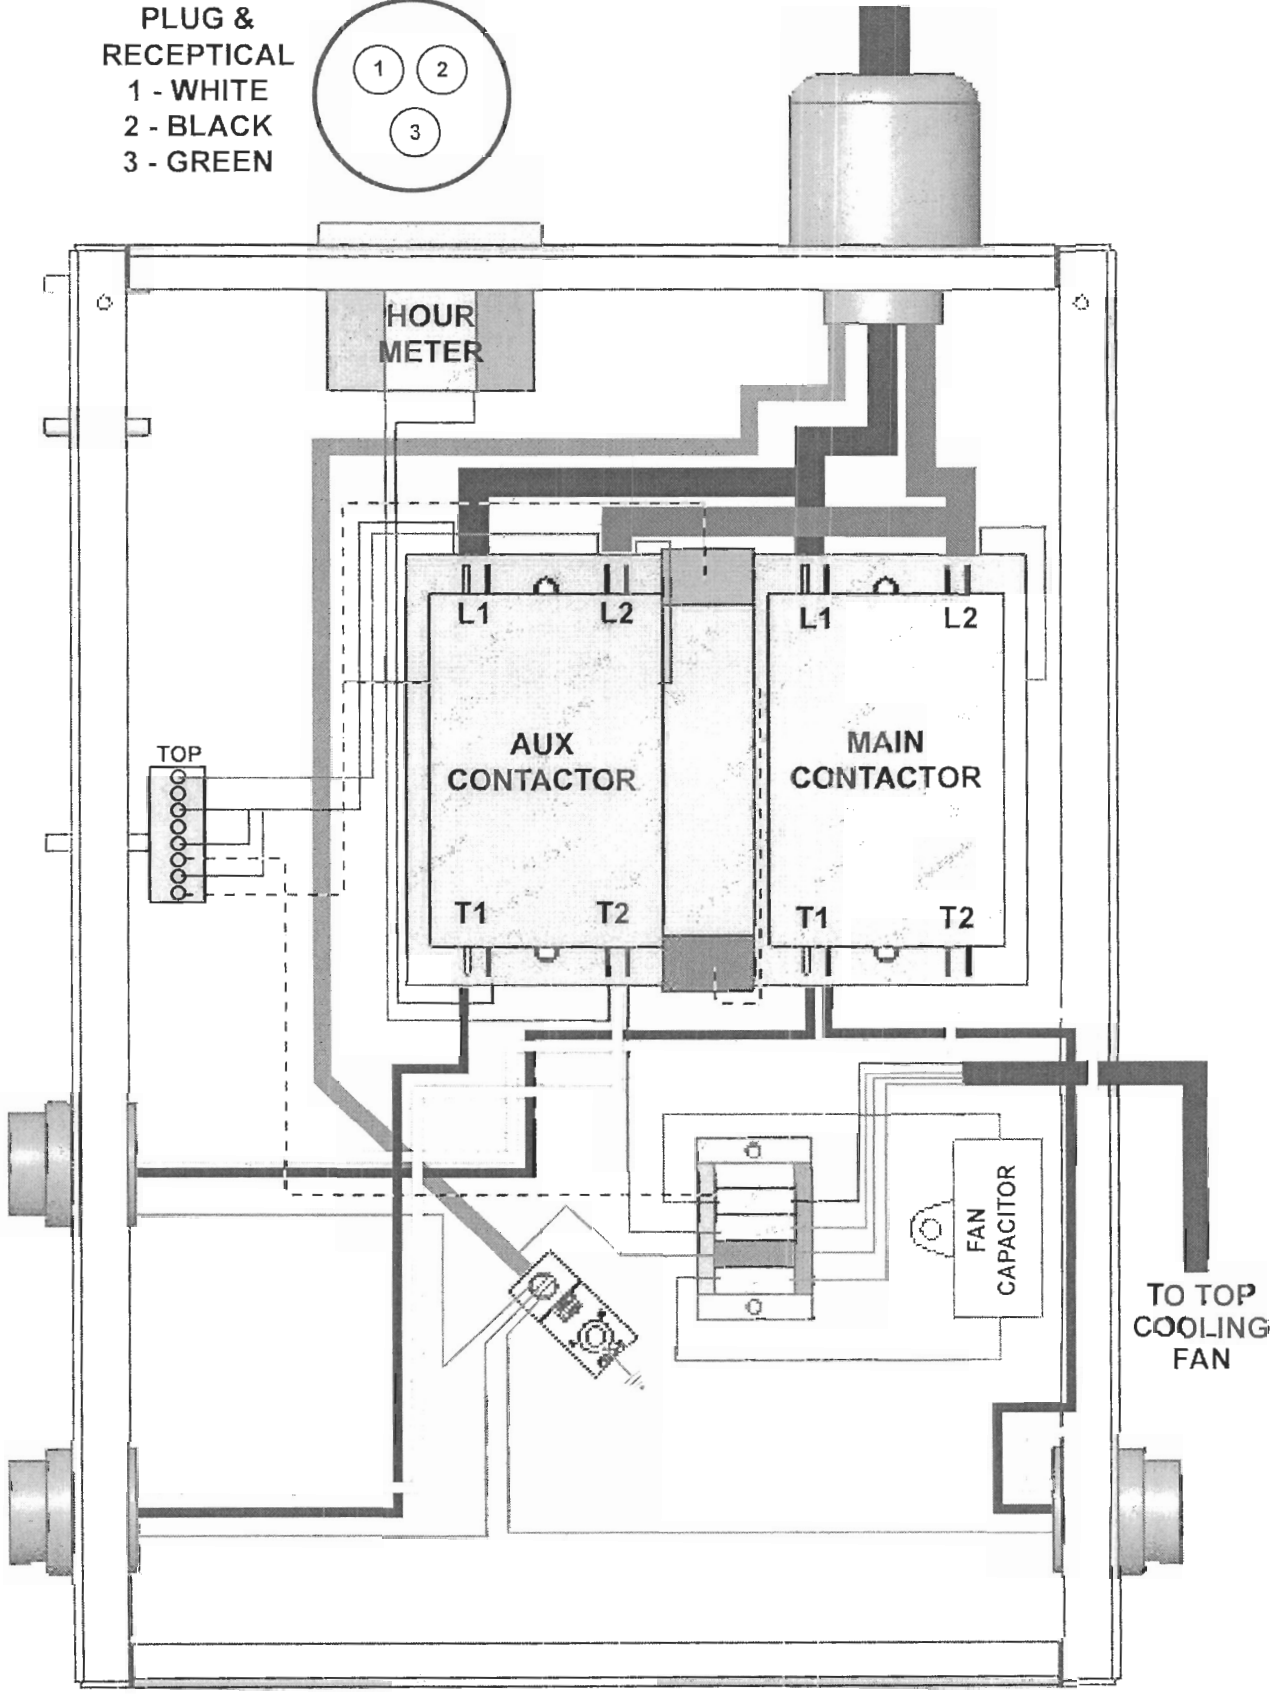

WIRING DIAGRAM LAMP PANELS

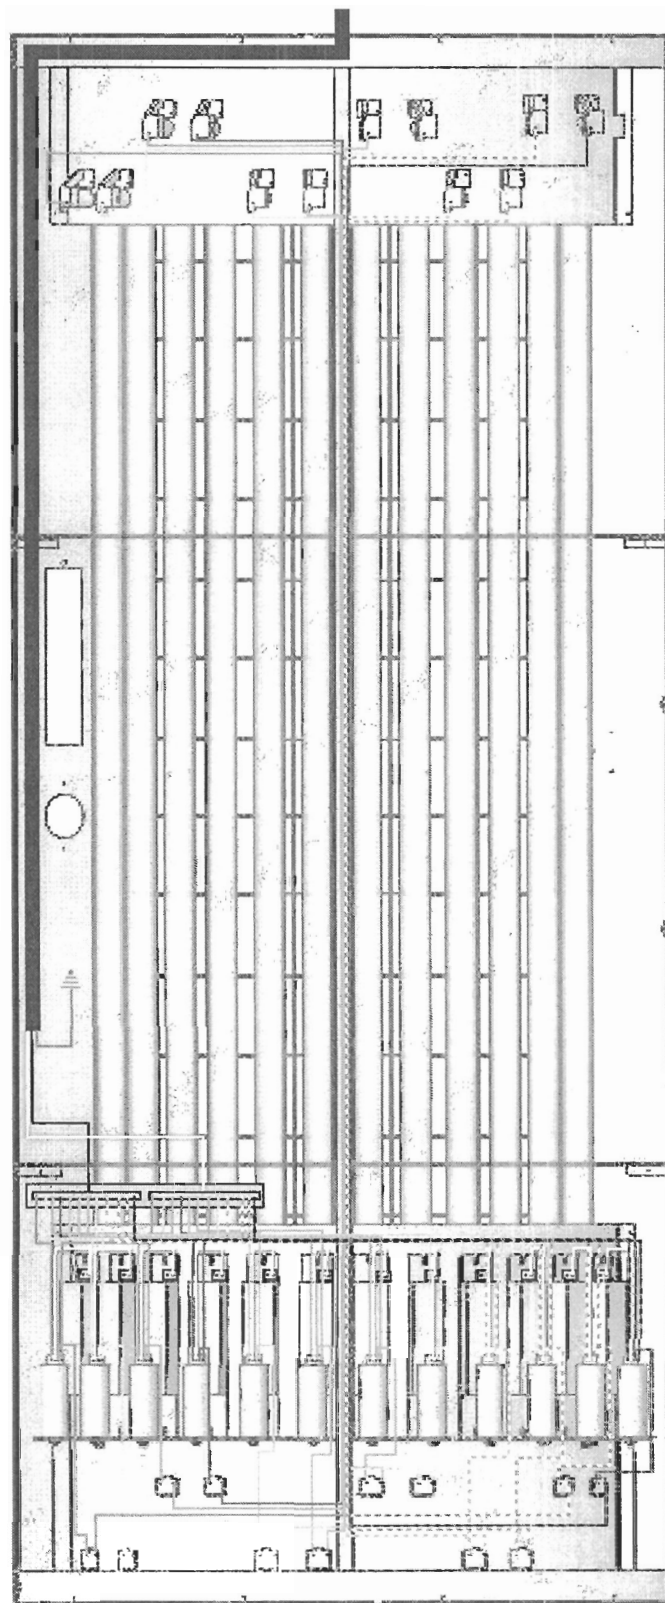

ELECTRICAL OVERVIEW

THIS UNIT REQUIRES 2 POLE
 230 VAC GROUND FIXED
 WIRING TO BE CONNECTED
 AT THE 2 POLE TERMINAL.
 BLOCK AND GROUNDING
 LUG LOCATED INSIDE
 THE REMOVABLE ACCESS
 PANEL. UNIT MUST BE
 CONNECTED ACCORDING
 TO LOCAL AND OR
 NATIONAL CODES WITH A
 MEANS OF DISCONNECTION.

